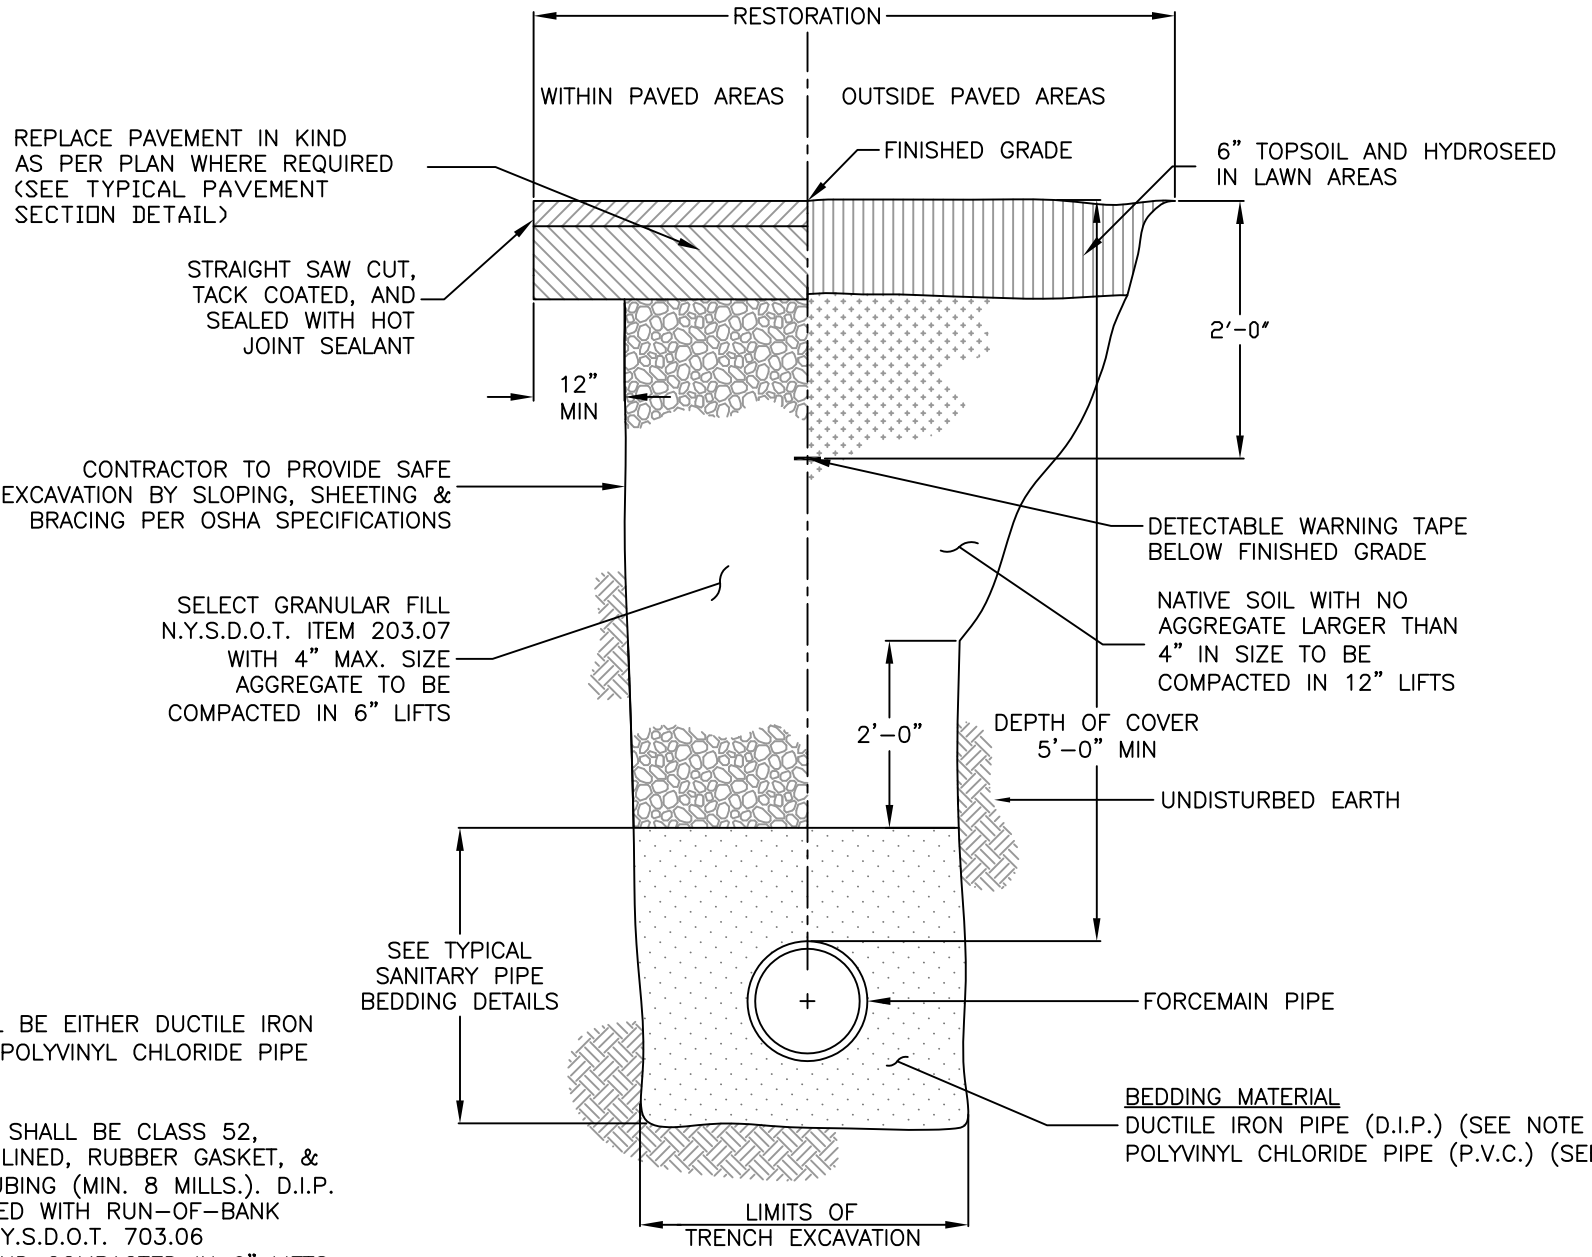

NOTES:

1. FORCEMAIN SHALL BE EITHER DUCTILE IRON PIPE (D.I.P.) OR POLYVINYL CHLORIDE PIPE (P.V.C.).

2. D.I.P. FORCEMAIN SHALL BE CLASS 52, DOUBLE CEMENT LINED, RUBBER GASKET, & POLYETHYLENE TUBING (MIN. 8 MILLS.). D.I.P. SHALL BE ENCASED WITH RUN-OF-BANK SAND MEETING N.Y.S.D.O.T. 703.06 SPECIFICATIONS AND COMPACTED IN 6" LIFTS.

3. P.V.C. FORCEMAIN SHALL HAVE A NO. 10 GAUGE TRACER WIRE ATTACHED TO PIPE. P.V.C. SHALL BE ENCASED WITH NO. 1 & NO. 2 MIXED CRUSHED WASHED STONE AND COMPACTED IN 6" LIFTS.

TOWN OF HENRIETTA

TYPICAL FORCEMAIN TRENCH DETAIL

SCALE: N.T.S.

DATE: 1/13/03

SA-21

\\Oserver\user folders\Town Projects\AutoCAD Projects\Non-Town Wide\Details\Sanitary\(SA-21)TypicalForcemainTrench.dwg