
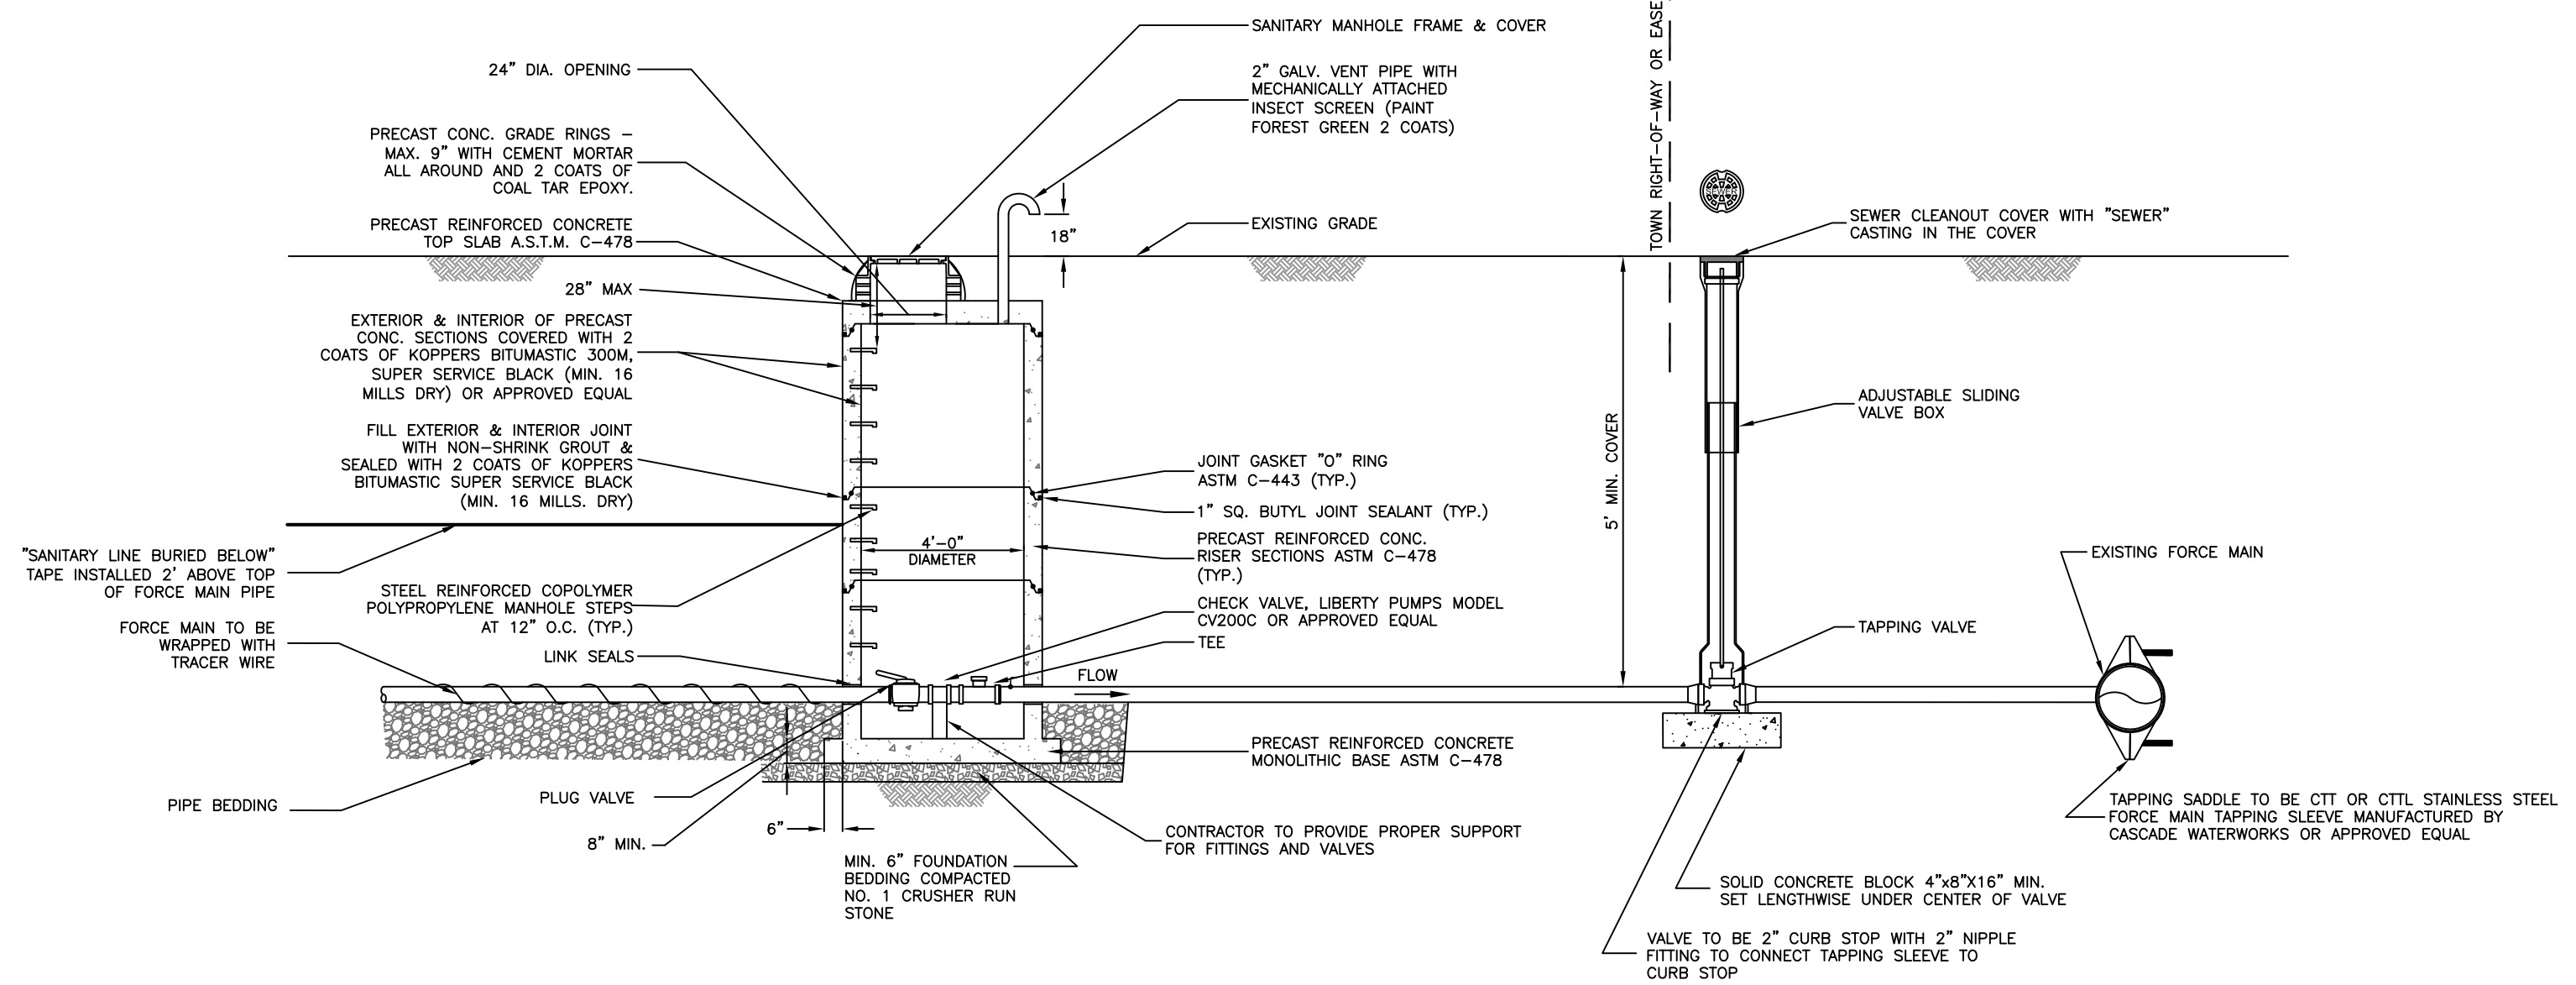



\\0server\user folders\Town Projects\AutoCAD Projects\Non-Town Wide\Details\Sanitary\SA-30\NewForceMainConnectionToExistingForceMain.dwg

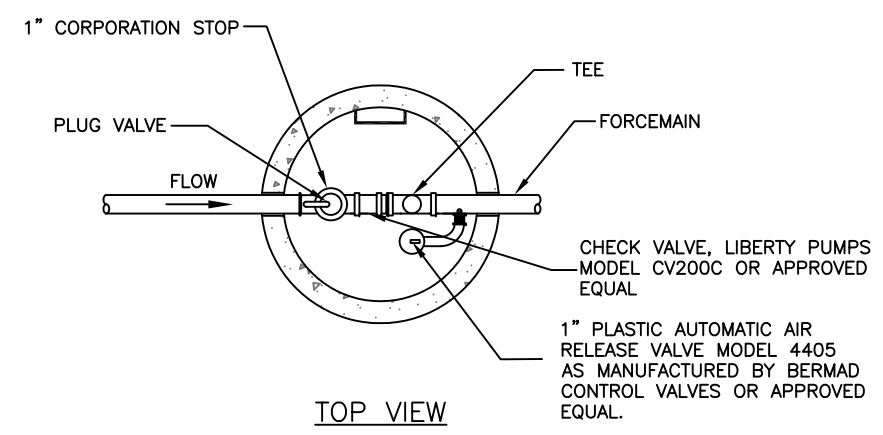

- NOTES:
1. PRECAST CONC. MANHOLE WALL & SLAB MINIMUM THICKNESS
 MANHOLE DIAMETER 4 FT.
 A. TOP SLAB 8"
 B. RISER WALL 5"
 C. BOTTOM SLAB 8"
 2. VALVE BOX SHALL BE CENTERED ON VALVE.
 3. TAPPING VALVE SHALL NOT SUPPORT VALVE BOX OR FORCEMAIN.

 TOWN OF HENRIETTA	NEW FORCE MAIN CONNECTION TO EXISTING FORCE MAIN DETAIL	
	SCALE: N.T.S.	SA-30
DATE: 7/5/2013		